

### Application

Designed for installation on water lines in fire protection systems to protect against both back-siphonage and backpressure of polluted water into the potable water supply. Assembly shall provide protection where a potential hazard exists (Low Hazard).

### Standards Compliance

Australian Watermark and Standards Mark

UL Classified

FM Approved

(This product contains a weighted average lead content less than 0.25% for surfaces in contact with water per the requirements of Clause A5G4 of NCC 2022 Vol 3)

(Plumbing Code of Australia)




### Materials

Main Valve Body	Ductile Iron ASTM A536
Access Covers	Ductile Iron ASTM A536
Coatings	Fusion Epoxy Finish AS/NZS 4158
Fastners	Stainless Steel, 300 Series
Internals	Stainless Steel, NORYL™
Elastomers	EPDM, Buna Nitrile
Springs	Stainless Steel, 300 Series



### Operating Parameters


Max. Working Water Pressure	1200kPa
Max. Working Temperature	60°C
Hydrostatic Test Pressure	2400kPa
End Connections Grooved	AWWA C606

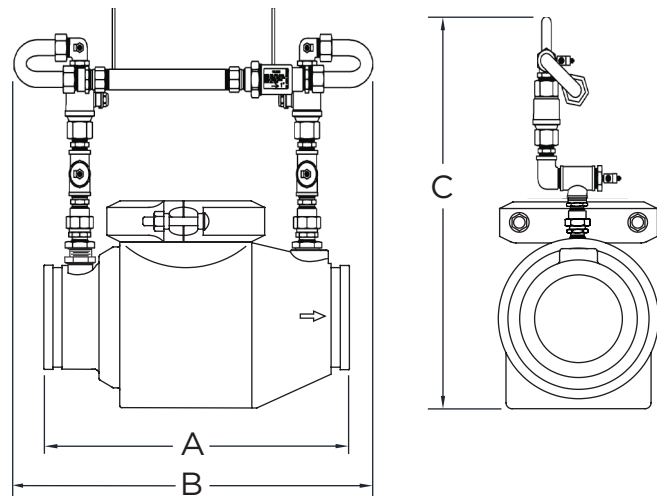

### Dimensions & Weights (do not include pkg.)

VALVE SIZE mm	BYPASS	REECE CODE	ZURN CODE	DIMENSIONS			WEIGHT kg
				A mm	B mm	C mm	
100	SPACER	1000612	SE100-310DAL25T(RG)	419	552	723	20.3
100	METER	1000627	YVW100-310DAL25T(RG)	419	552	723	20.3
150	SPACER	1000614	SE150-310DAL25T(RG)	572	705	530	50.9
150	METER	1000629	YVW150-310DAL25T(RG)	572	705	530	50.9

Flow Characteristics

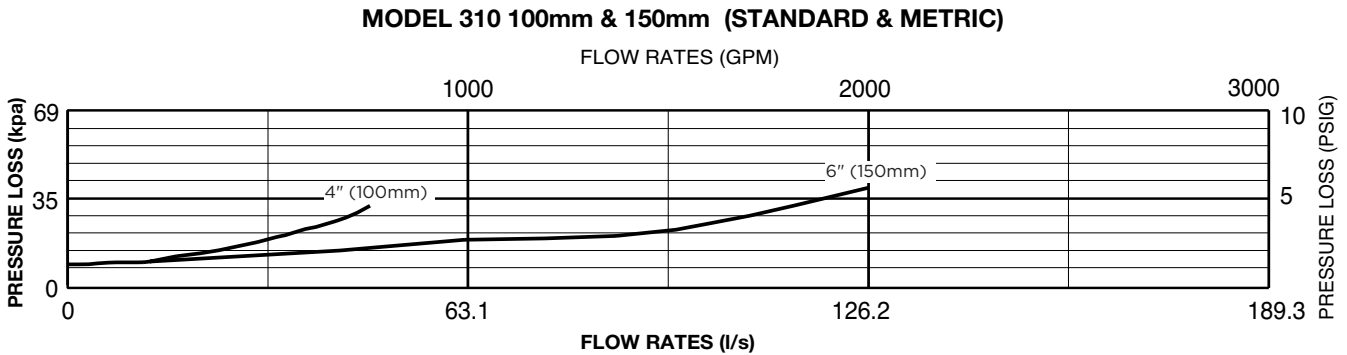

Note: The pressure losses depicted in the tables are for the device only and not the complete assembly.

Typical Installation

Local codes shall govern installation requirements. Unless otherwise specified, the assembly shall be mounted at a minimum of 12" (305mm) and a maximum of 30" (762mm) above adequate drains with sufficient side clearance for testing and maintenance. The installation shall be made so that no part of the unit can be submerged.

Specifications

The Single Detector Check Valve shall be certified to AS/NZS 2845.1. The main body and access cover shall be epoxy coated ductile iron (ASTM A 536), the seat ring and check valve shall be NORYL™, the stem shall be stainless steel (ASTM A 276) and the seat disc elastomers shall be EPDM. The check valve shall be spring loaded and accessible for maintenance without removing the device from the line. The Single Detector Check Valve shall be a ZURN WILKINS Model 310.