

Application

Designed for installation on potable water lines to protect against both backsiphonage and backpressure of polluted water into the potable water supply. The Model 350A shall provide protection where a potential health hazard exists (Medium Hazard).

Standards Compliance

Australian Watermark and Standards Mark

UL Classified

FM Approved

(This product contains a weighted average lead content less than 0.25% for surfaces in contact with water per the requirements of Clause A5G4 of NCC 2022 Vol 3)

(Plumbing Code of Australia)



LEAD FREE

Operating Parameters

Max. Working Water Pressure	1200kPa
Max. Working Temperature	60°C
Hydrostatic Test Pressure	2400kPa
End Connections	Grooved, AWWA C606



LEAD FREE
AS/NZS 2845.1
LIC. WMKA1379




STANDARDS MARK
AS/NZS 2845.1
LIC. SMK1379



Materials

Main Valve Body	Ductile Iron ASTM A536
Access Covers	Ductile Iron ASTM A536
Coatings	Fusion Epoxy Finish AZ/NZS 4158
Fasteners	Stainless Steel, 300 Series
Internals	Stainless Steel, 300 Series
Seal Ring	EPDM
O-ring	Buna Nitrile
Springs	Stainless Steel, 300 Series

Dimensions & Weights (do not include pkg.)

VALVE SIZE mm	REECE CODE	ZURN CODE	DIMENSIONS (approximate) A mm	WEIGHT Kg
100	4000017	4-350ALBS	505	34
150	4000049	6-350ALBS	657	57
200	4000082	8-350ALBS	978	130

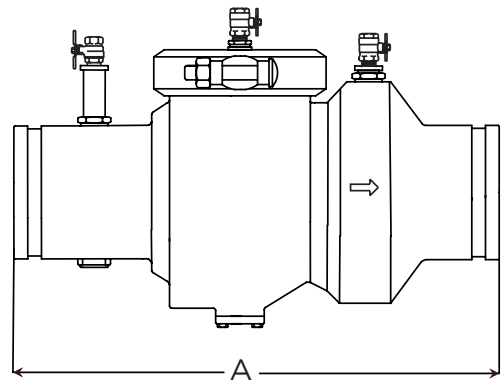

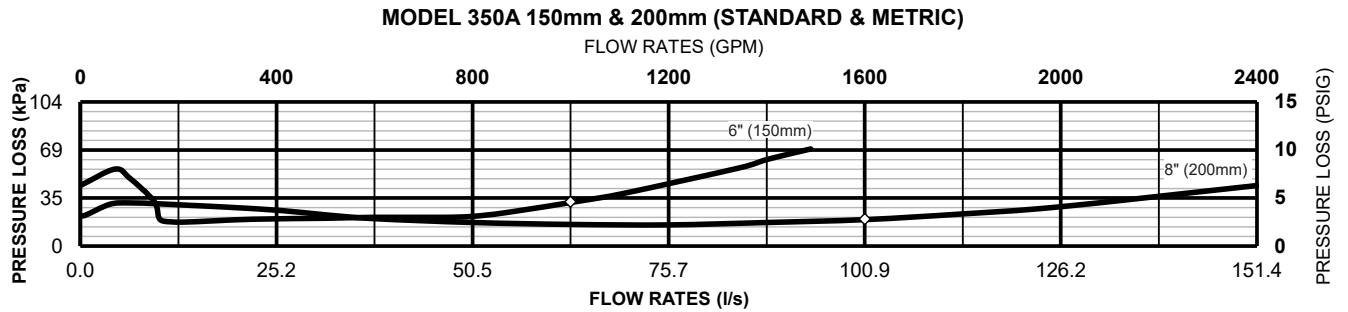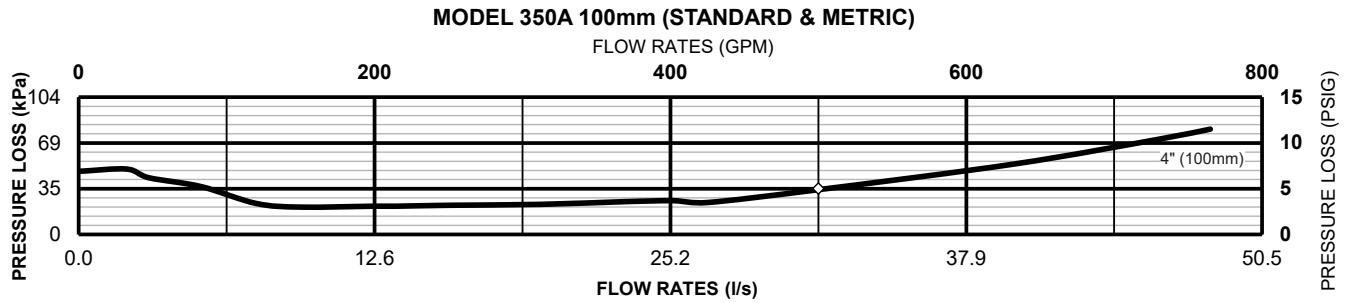

Note: The pressure losses depicted in the tables are for the device only and not the complete assembly.

Typical Installation

Local codes shall govern installation requirements. To be installed in accordance with the manufacturers’ instructions and the latest edition of the Plumbing Code of Australia and/or AS/NZS 3500. Unless otherwise specified, the assembly shall be mounted at a minimum of 12” (305mm) and a maximum of 30” (762mm) above adequate drains with sufficient side clearance for testing and maintenance. If installed below grade, be certain adequate drainage is provided to prevent the device from being submerged.

Specifications

The Double Check Valve shall be certified to AS/NZS 2845.1. The main body and access cover shall be epoxy coated ductile iron (ASTM A 536), the seat ring and check valve shall be NORYL™, the stem shall be stainless steel (ASTM A 276) and the seat disc elastomers shall be EPDM. The checks shall be accessible for maintenance without removing the device from the line. The Double Check Valve shall be a ZURN WILKINS Model 350A.